


McNulty Slough Data Summary

Date	Temp C	SpCond mS/cm	Salinity ppt	DO Conc mg/L	pH	Turbidity NTU
1/7/2011	7.68	2.91	1.52	8.36	7.09	15.05
1/21/2011	9.45	5.55	3.01	8.92	7.43	19.14
2/4/2011	9.81	25.14	15.29	9.50	7.74	6.27
2/18/2011	6.50	12.53	7.16	9.86	7.46	11.99
3/4/2011	8.50	5.99	3.26	8.18	7.23	22.84
3/18/2011	9.33	2.30	1.19	9.41	7.25	26.89
4/4/2011	13.01	2.86	1.49	8.45	7.09	38.77
4/15/2011	11.70	4.46	2.39	8.71	7.42	44.60
4/29/2011	18.18	4.39	2.35	9.93	7.74	48.84
5/13/2011	13.60	18.07	10.72	4.77	6.93	8.97
5/27/2011	16.03	22.89	13.87	6.82	7.42	10.03
6/3/2011	15.06	17.50	10.36	5.38	7.24	15.71
6/17/2011	20.46	22.49	13.59	7.14	7.76	10.51
7/5/2011	21.73	33.16	20.78	11.79	8.22	10.84
7/14/2011	19.43	35.55	22.47	8.75	7.82	6.79
7/28/2011	19.16	29.64	18.40	5.57	7.99	4.68
8/11/2011	20.34	28.84	17.84	4.72	8.00	2.84
8/25/2011	20.03	45.69	29.66	4.31	7.49	4.33
9/8/2011	15.78	47.45	30.92	2.79	7.29	7.58
9/22/2011	17.60	47.28	30.82	3.71	7.33	7.64
10/5/2011	13.22	43.88	28.29	4.61	7.19	7.32
10/13/2011	16.79	38.55	24.57	5.51	7.37	6.84
10/27/2011	11.70	44.96	29.01		7.65	7.70
10/28/2011	12.11	46.48	30.11	7.53	7.64	6.39
11/10/2011	11.74	43.22	27.77	8.22	7.57	9.20
11/28/2011	11.48	35.56	22.39	8.17		8.34
12/8/2011	9.29	39.22	24.84	7.24	7.40	11.89
12/15/2011	7.89	44.23	28.27	8.76	7.38	12.50
12/22/2011	9.02	45.26	29.08	7.59	7.39	11.58
1/5/2012	11.38	35.11	22.08	8.54	7.82	15.53
1/20/2012	9.92	38.30	24.23	7.48	7.53	12.51
1/27/2012	9.89	4.94	2.66	3.98	6.78	11.19
2/9/2012	10.76	37.03	23.38	8.61	7.75	20.29
2/23/2012	10.93	30.59	18.97	7.25	7.38	41.01
Mean	13.22	27.71	17.43	7.29	7.48	14.90


Exceedance of Applicable Water Quality Criteria

Parameter	Criteria	Source
Dissolved Oxygen	6.0 mg/L (min)	NCRQCB Basin Plan, Objectives for Inland Waters, Enclosed Bays and Estuaries
pH	6.5 - 8.5 (range)	NCRQCB Basin Plan, Objectives for Inland Waters, Enclosed Bays and Estuaries

McNulty Slough Water Quality Figures

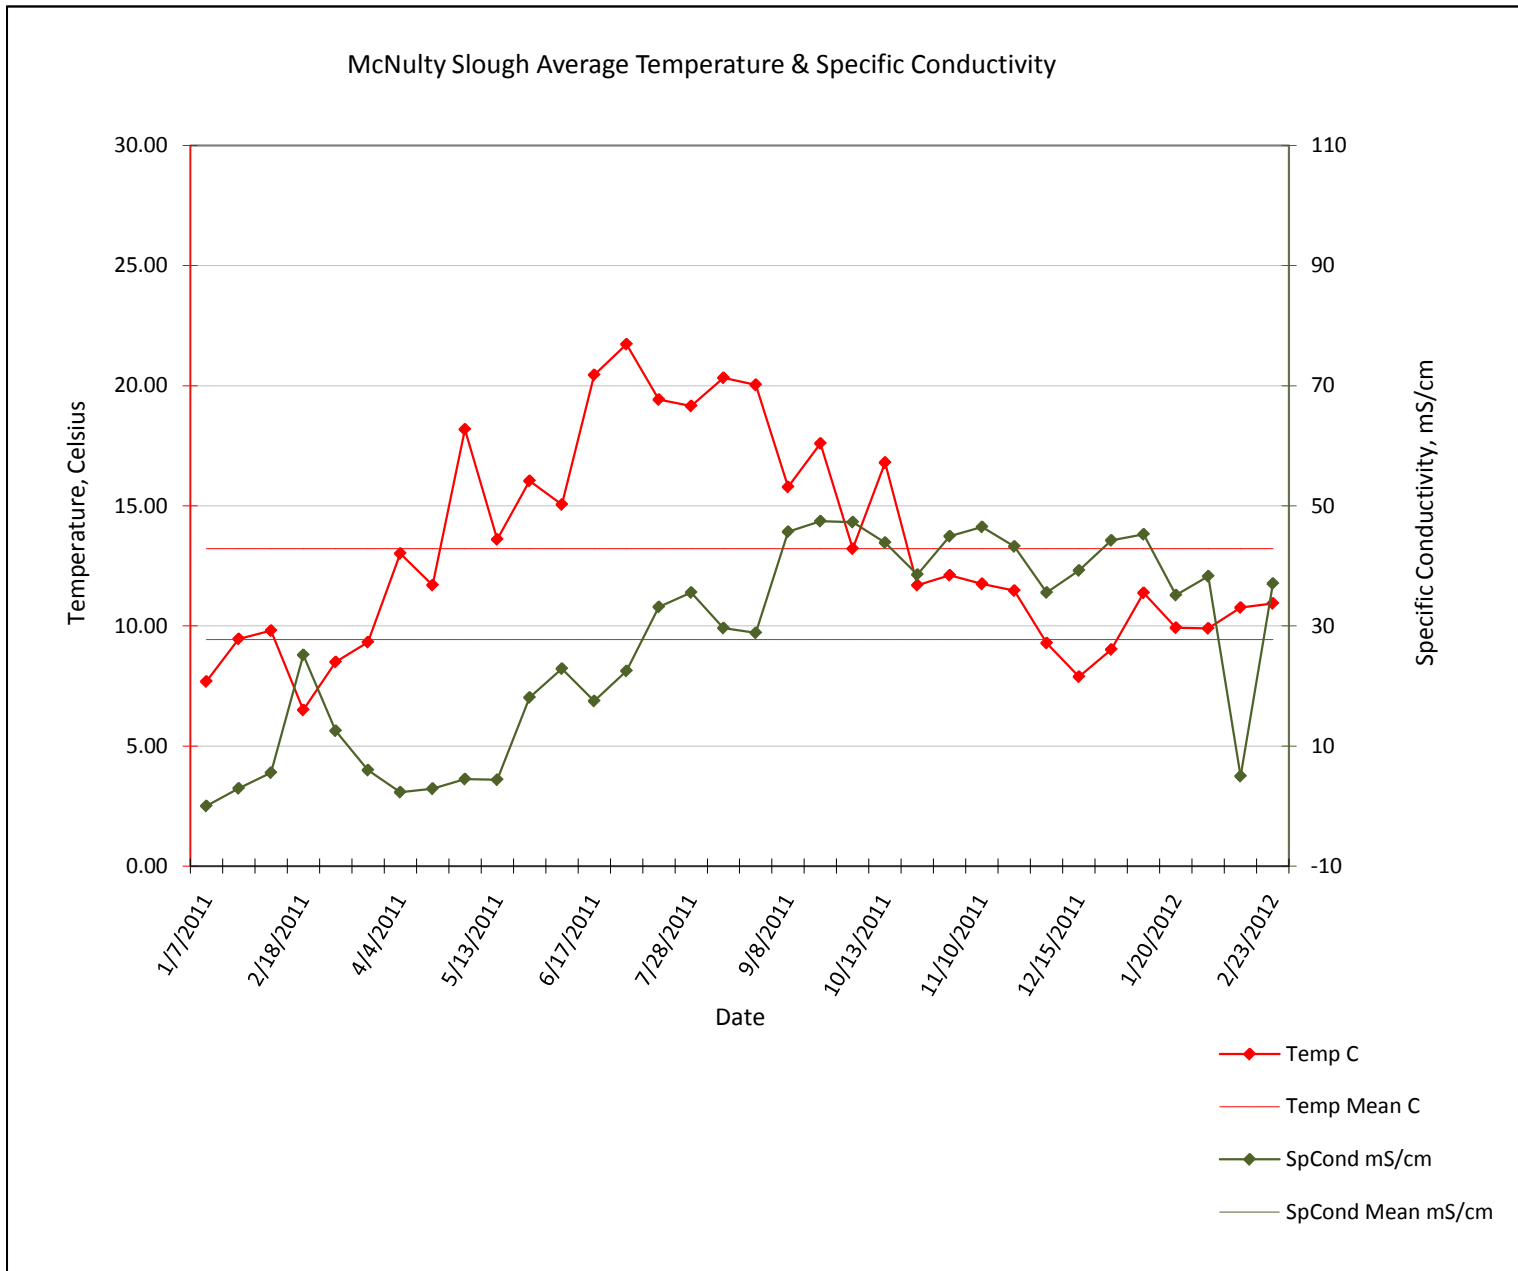

McNulty Slough Water Quality Figures

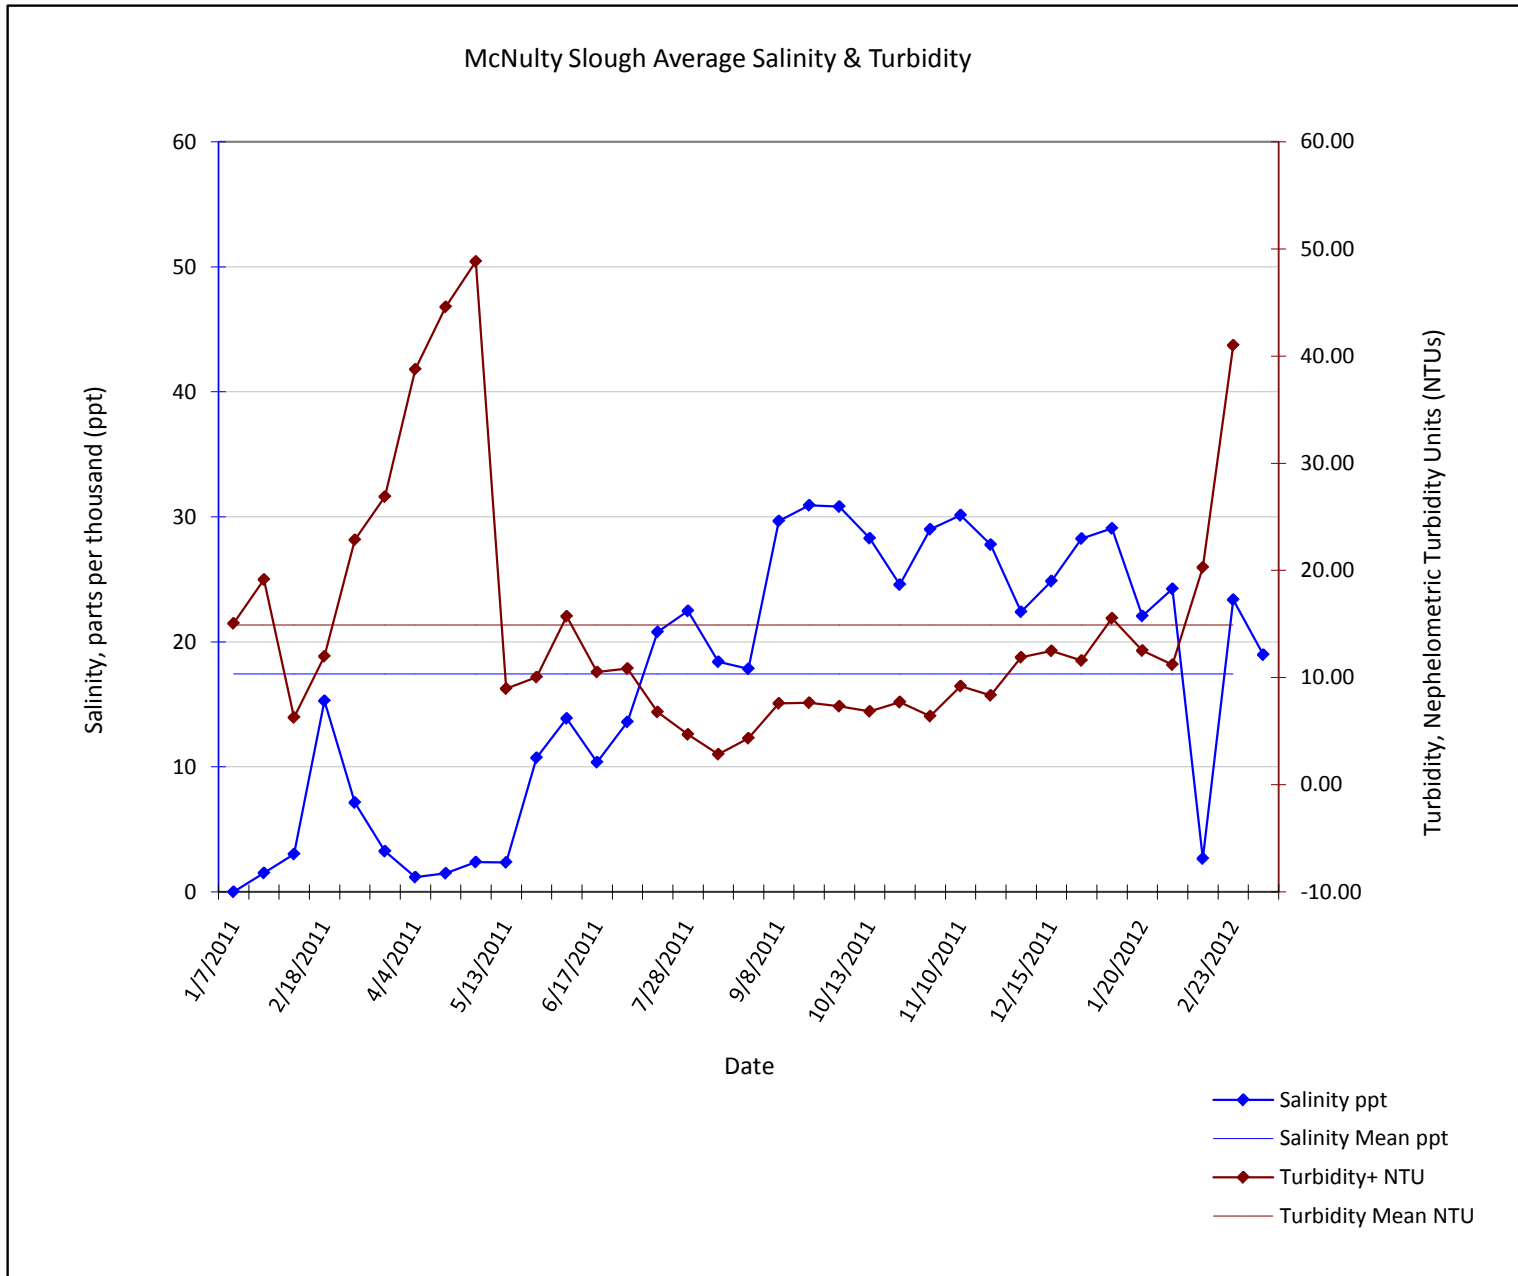

McNulty Slough Water Quality Figures

