

## Hookton Slough Data Summary

Date	Temp C	SpCond mS/cm	Salinity ppt	DO Conc mg/L	pH	Turbidity NTU
6/2/2011	15.25	43.37	27.97	9.97	7.84	6.51
6/16/2011	18.59	48.11	31.43	9.09	7.98	6.67
6/30/2011	18.81	39.71	25.39	9.49	7.98	16.12
7/13/2011	20.11	49.24	32.25	7.99	7.95	11.00
7/27/2011	20.12	47.22	30.77	7.15	7.92	12.16
8/10/2011	18.70	48.76	31.90	9.31	7.97	7.91
8/24/2011	21.04	49.30	32.29	6.36	7.85	9.54
9/15/2011	17.50	50.37	33.07	8.52	7.84	8.66
9/21/2011	17.51	49.70	32.58	6.78	7.86	8.31
10/12/2011	16.55	45.17	29.28	8.96	7.90	10.09
11/3/2011	11.68	45.57	29.45	9.77	7.83	5.09
11/9/2011	12.06	38.01	24.11	11.97		22.24
12/7/2011	8.83	42.34	27.00	11.00	7.67	27.23
12/21/2011	8.84	46.52	29.96	11.14	7.86	36.32
1/5/2012	10.60	42.16	26.97	9.98	7.85	15.28
1/19/2012	8.75	14.85	8.63	10.05	7.19	373.64
1/26/2012	11.29	37.48	23.72	8.48	7.80	13.19
2/8/2012	12.05	41.55	26.60	9.97	7.95	10.32
2/22/2012	12.41	39.33	25.04	9.64	7.87	12.94
3/8/2012	10.54	37.19	23.49	10.88	7.87	19.45
3/22/2012	9.91	36.71	23.14	8.70	8.03	14.82
4/5/2012	11.35	9.63	5.45	10.67	7.29	41.79
4/19/2012	13.09	38.07	24.18	8.19	7.66	9.13
5/3/2012	13.40	34.43	21.66	9.20	7.86	10.12
5/16/2012	16.60	40.32	25.82	8.19	7.92	7.87
5/31/2012	20.16	40.35	25.84	8.80	7.74	10.64
6/14/2012	17.57	43.46	28.06	8.50	8.02	6.32
6/28/2012	17.83	48.70	31.85	7.21	7.78	5.46
7/12/2012	16.88	48.72	31.86	6.29	7.62	6.31
7/19/2012	17.51	49.25	32.25	7.88	8.01	5.77
7/31/2012	17.53	49.93	32.75	7.89	8.06	7.31
8/16/2012	18.62	50.55	33.21	7.45	7.96	6.37
8/29/2012	20.54	51.12	33.63	7.95	8.07	6.75
9/20/2012	14.65	50.60	33.19	6.52	7.78	7.22
10/4/2012	14.67	50.57	33.17	7.32	7.86	6.40
10/18/2012	15.32	49.58	32.46	8.08	7.88	7.09
11/1/2012	14.64	49.21	32.18	8.63	7.90	4.19
11/15/2012	11.83	49.11	32.00	8.90	7.87	5.32
12/4/2012	11.74	32.76	20.47	8.83	7.71	28.78
12/13/2012	9.43	43.58	27.91	8.56	7.83	9.56
Mean	14.86	43.07	27.82	8.76	7.84	21.00


### Exceedance of Applicable Water Quality Criteria

Parameter	Criteria	Source
-----------	----------	--------


### Hookton Slough Data Summary

Date	Temp C	SpCond mS/cm	Salinity ppt	DO Conc mg/L	pH	Turbidity NTU
Dissolved Oxygen	6.0 mg/L (min)		NCRQCB Basin Plan, Objectives for Inland Waters, Enclosed Bays and Estuaries			
pH	7.0 - 8.5 (range)		NCRQCB Basin Plan, Objectives for Inland Waters,			

# Hookton Slough Water Quality Figures

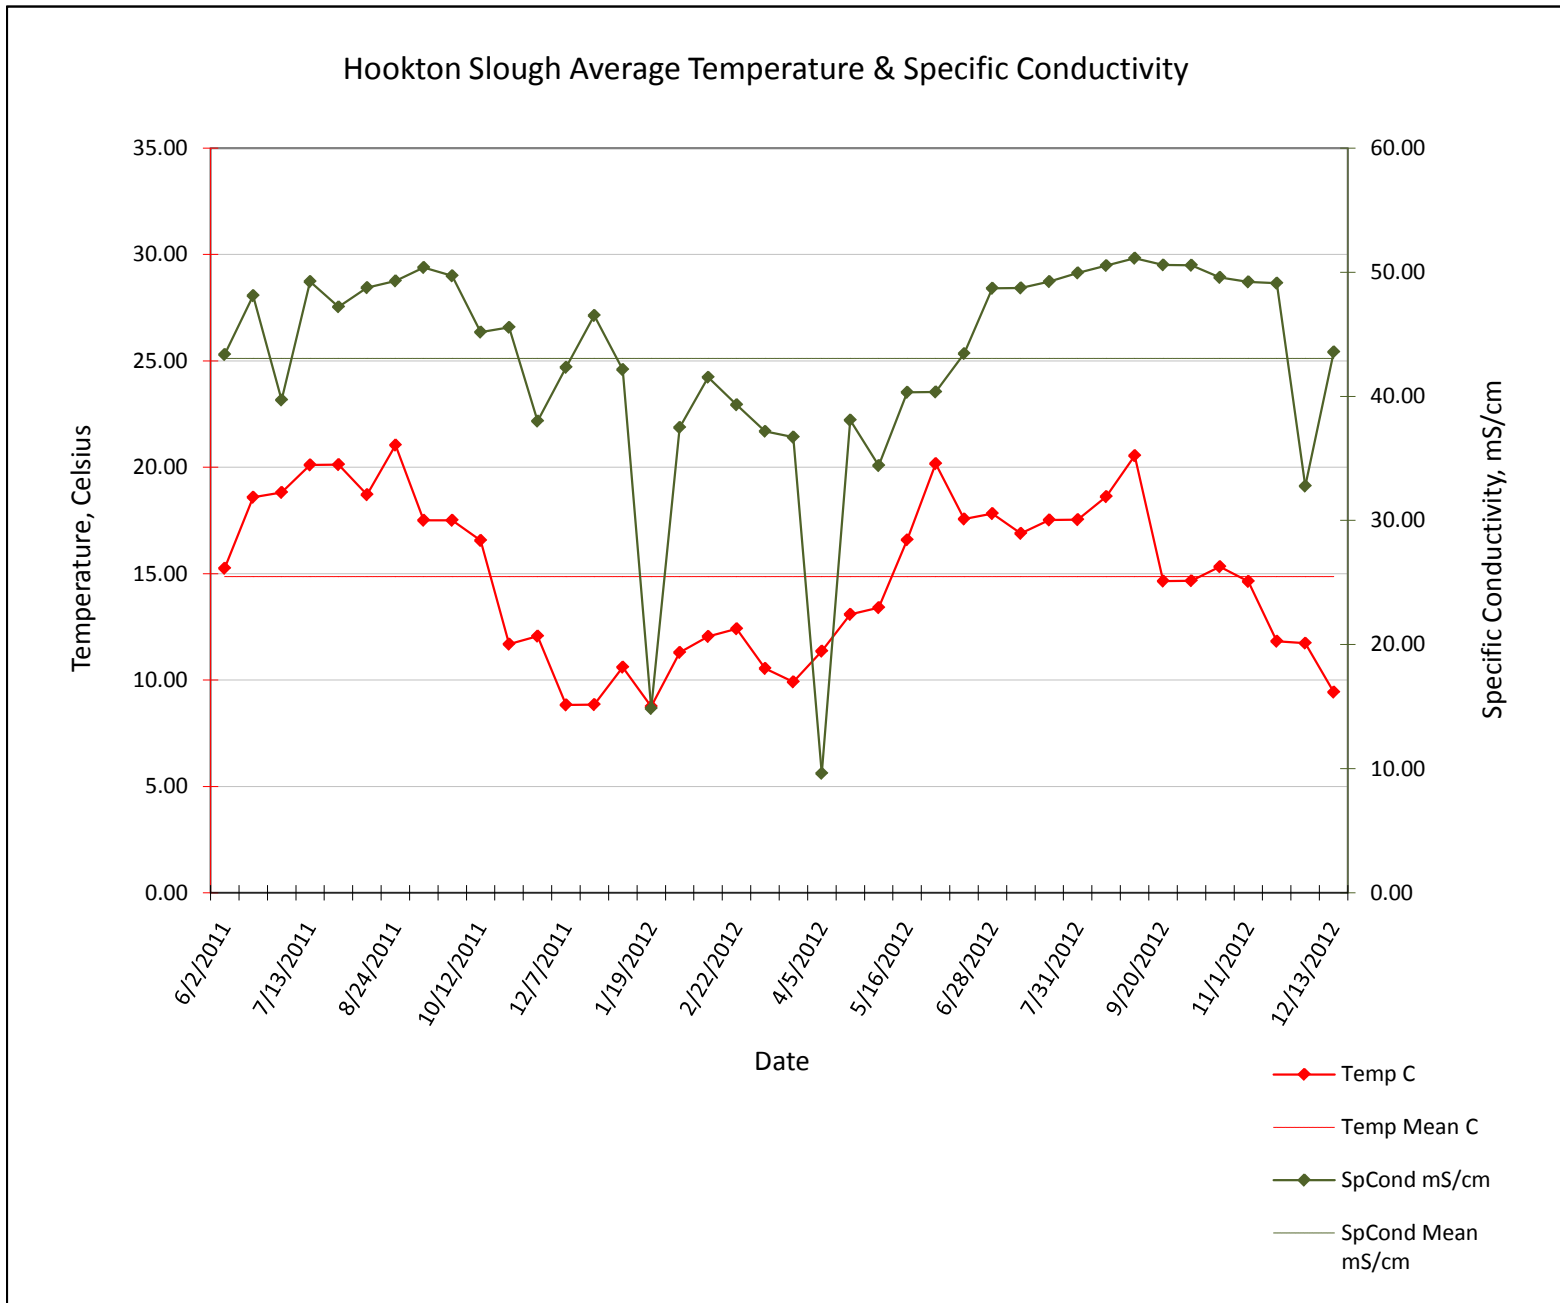

# Hookton Slough Water Quality Figures

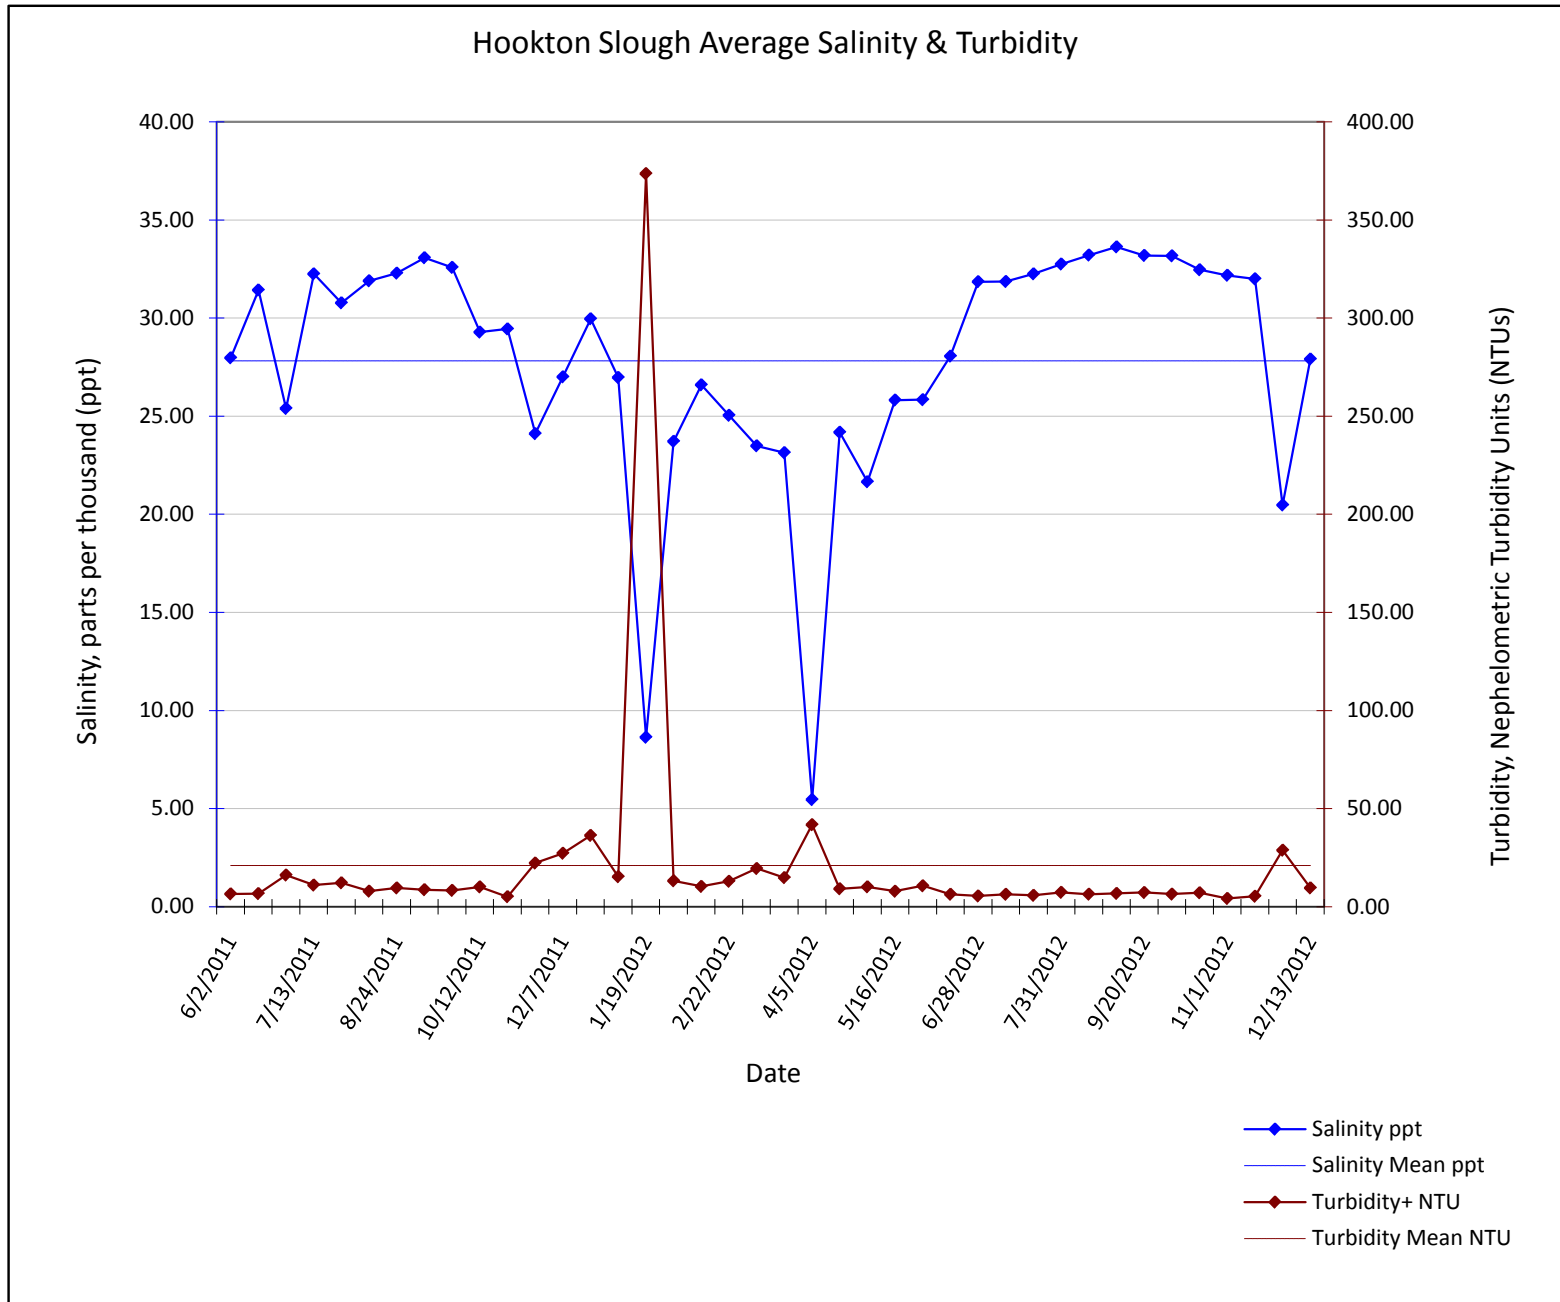

# Hookton Slough Water Quality Figures

